


TYPICAL WATER METER INSTALLATION

(NOT TO SCALE)

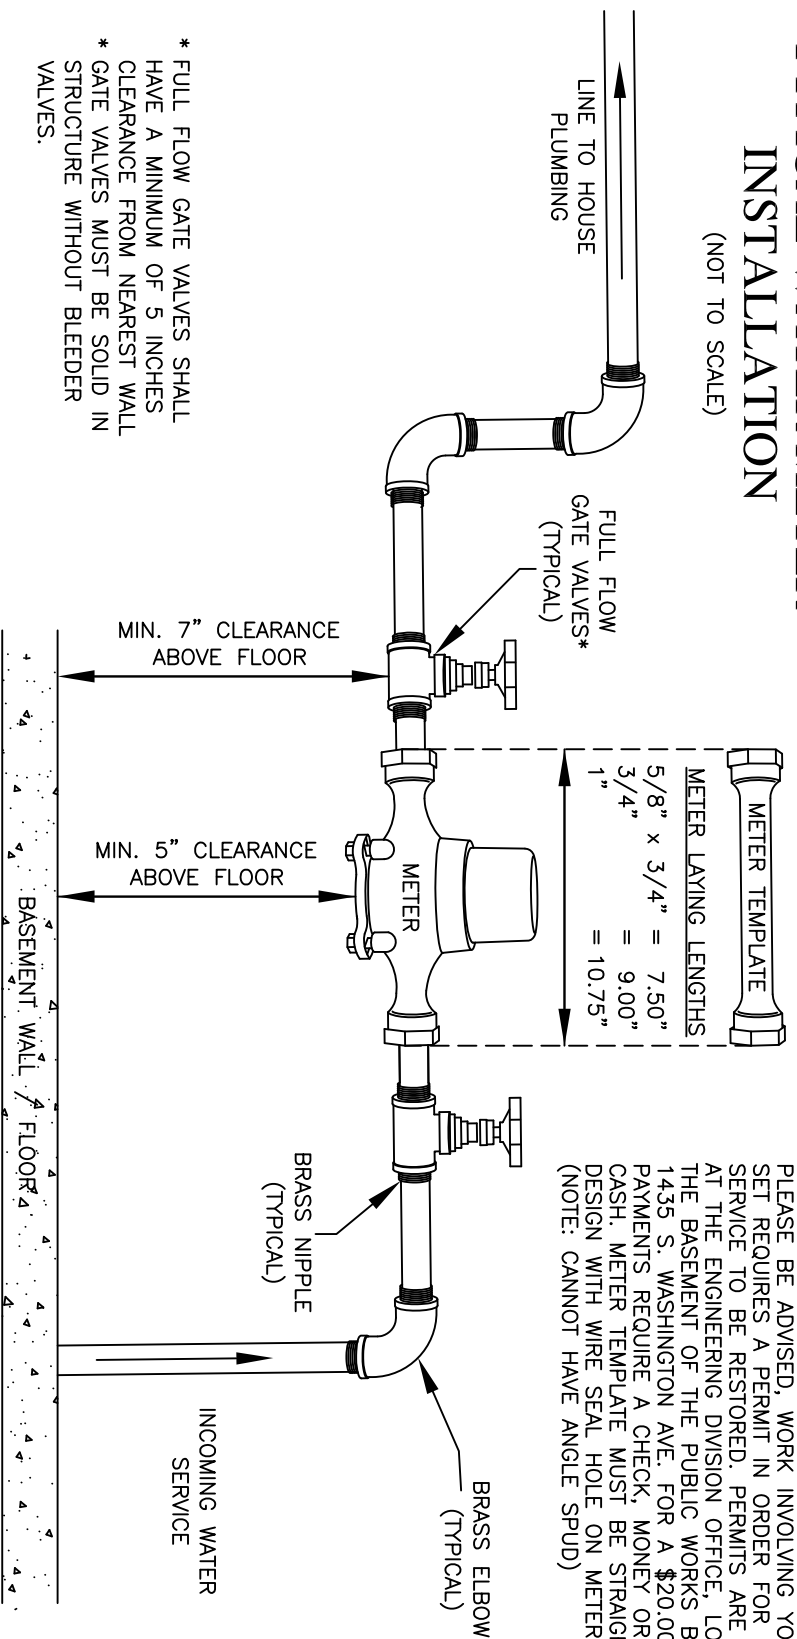

METER SET PERMIT REQUIREMENT

PLEASE BE ADVISED, WORK INVOLVING YOUR METER SET REQUIRES A PERMIT IN ORDER FOR WATER SERVICE TO BE RESTORED. PERMITS ARE AVAILABLE AT THE ENGINEERING DIVISION OFFICE, LOCATED IN THE BASEMENT OF THE PUBLIC WORKS BUILDING, 1435 S. WASHINGTON AVE. FOR A \$20.00 FEE. ALL PAYMENTS REQUIRE A CHECK, MONEY ORDER, OR CASH. METER TEMPLATE MUST BE STRAIGHT BAR DESIGN WITH WIRE SEAL HOLE ON METER SPUDS. (NOTE: CANNOT HAVE ANGLE SPUD)

- ALL MATERIALS MUST BE TYPE "K" COPPER AND BRASS FITTINGS ONLY.
- VALVES MUST BE FULL FLOW GATE TYPE ONLY, AND ARE TO BE INSTALLED ON THE INLET AND OUTLET SIDES OF THE METER LOCATED NO MORE THAN TWELVE INCHES (12") UPSTREAM AND DOWNSTREAM, AND MUST BE ACCESSIBLE.
- ABSOLUTELY NO SOLDER TYPE JOINTS, INCLUDING SILVER SOLDER, ALLOWED UNTIL AFTER SECOND GATE VALVE OR ENTIRE METER SET.
- SERVICE LINE MUST BE AT LEAST FIVE FEET (5') DEEP THE ENTIRE LENGTH FROM CURB-STOP TO INSIDE OF BASEMENT WALL UNLESS THERE IS NO BASEMENT; THEN IT MUST MAINTAIN A DEPTH OF FIVE FEET (5') TO A POINT EIGHTEEN INCHES (18") INSIDE OF FOOTING.
- ALL REPAIRS MUST BE INSPECTED BEFORE BACKFILLING. CONTACT MAINTENANCE AND SERVICE FOR INSPECTION AT 989-759-1612.
- METERS WILL BE SET WHERE THE SERVICE LINE FIRST ENTERS THE BUILDING. METERS ARE NOT ALLOWED UNDER HOMES OR OTHER INACCESSIBLE AREAS. AT LEAST EIGHTEEN INCHES (18") OF CLEARANCE ABOVE METER MUST BE MAINTAINED AND IT CANNOT BE OVER FOUR FEET (4') ABOVE THE FLOOR, BUT MUST BE AT LEAST FIVE INCHES (5") ABOVE FLOOR.
- METER TEMPLATE SHALL BE PURCHASED (Check or Money Order only) FROM THE MAINTENANCE AND SERVICE DIVISION OF THE DEPARTMENT OF PUBLIC SERVICES LOCATED AT 1701 S. JEFFERSON AVENUE.
- METER SHALL BE INSTALLED BY AUTHORIZED MAINTENANCE AND SERVICE PERSONNEL ONLY.